

Must be within 15ft conduit length of battery cabinets


One (1) 1/2" conduit from wall-mount enclosure to Splitter
1. This conduit is to house a single 4-conductor 18-gauge communication cable

Wall-mounted Splitter
-Requires 120VAC fed from UPS

Command Control Module

Rack-mount control module.
-Requires one (1) dedicated 120VAC circuit fed from UPS

Four (4) separate 3/4" conduits to house:
-One 4-conductor CT communication cable
-One 2-conductor Thermistor cable
-One pair of fiber-optic communication cable to/from BACS modules

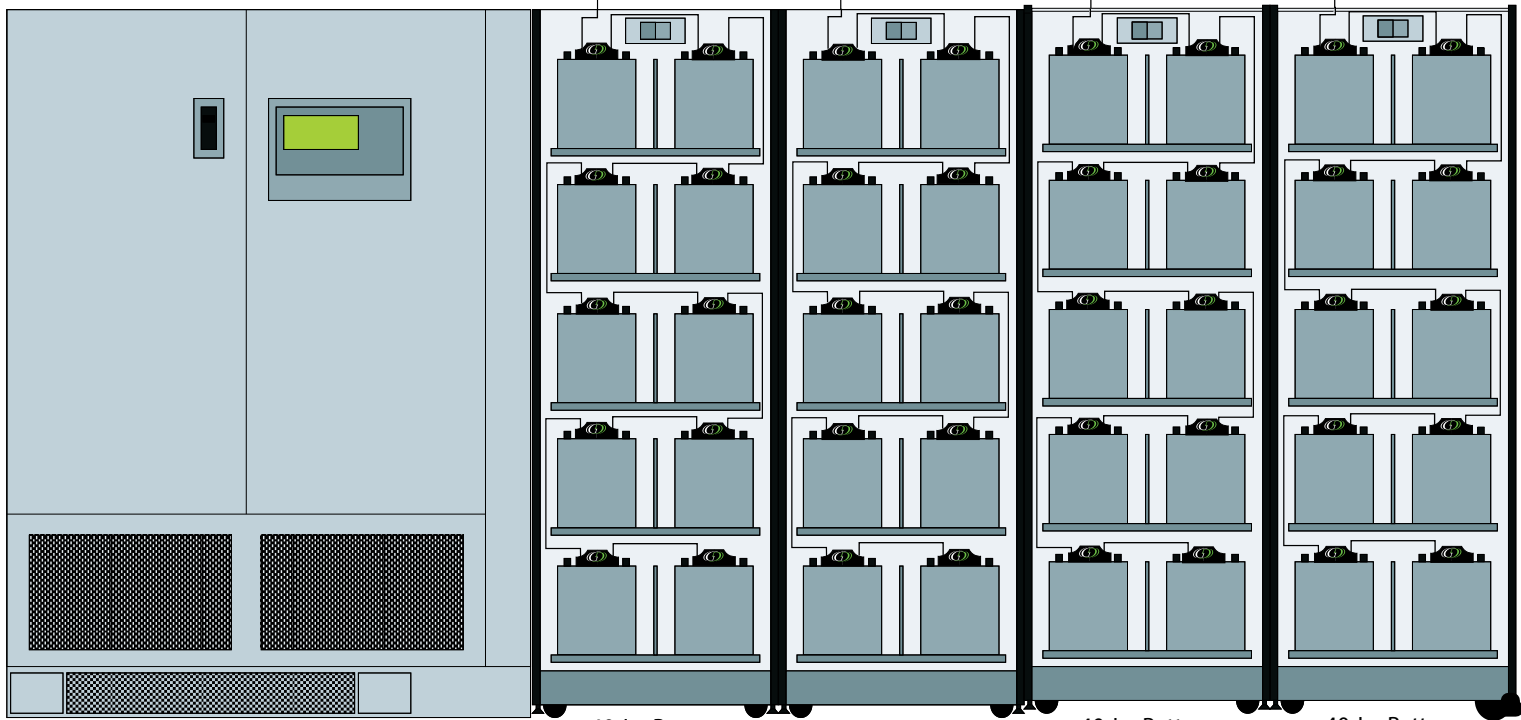

500 KVA UPS

40 Jar Battery Cab "A"

40 Jar Battery Cab "B"

40 Jar Battery Cab "C"

40 Jar Battery Cab "D"